


89



- NOTES:**
- 1) SCHEDULE 80 PVC CONDUIT SHALL BE THREAD-FIT INTO COUPLER AND EXTEND 25MM (1")MIN, TO 50MM (2")MAX. ABOVE TOP FACE OF BASE PLATE.
 - 2) PVC CONDUIT-COUPLER JOINT AREA SHALL BE WRAPPED IN CONSTRUCTION-GRADE WATERPROOF PAPER PRIOR TO INSTALLING MORTAR.

NO.	REVISIONS	BY	DATE	APP'D

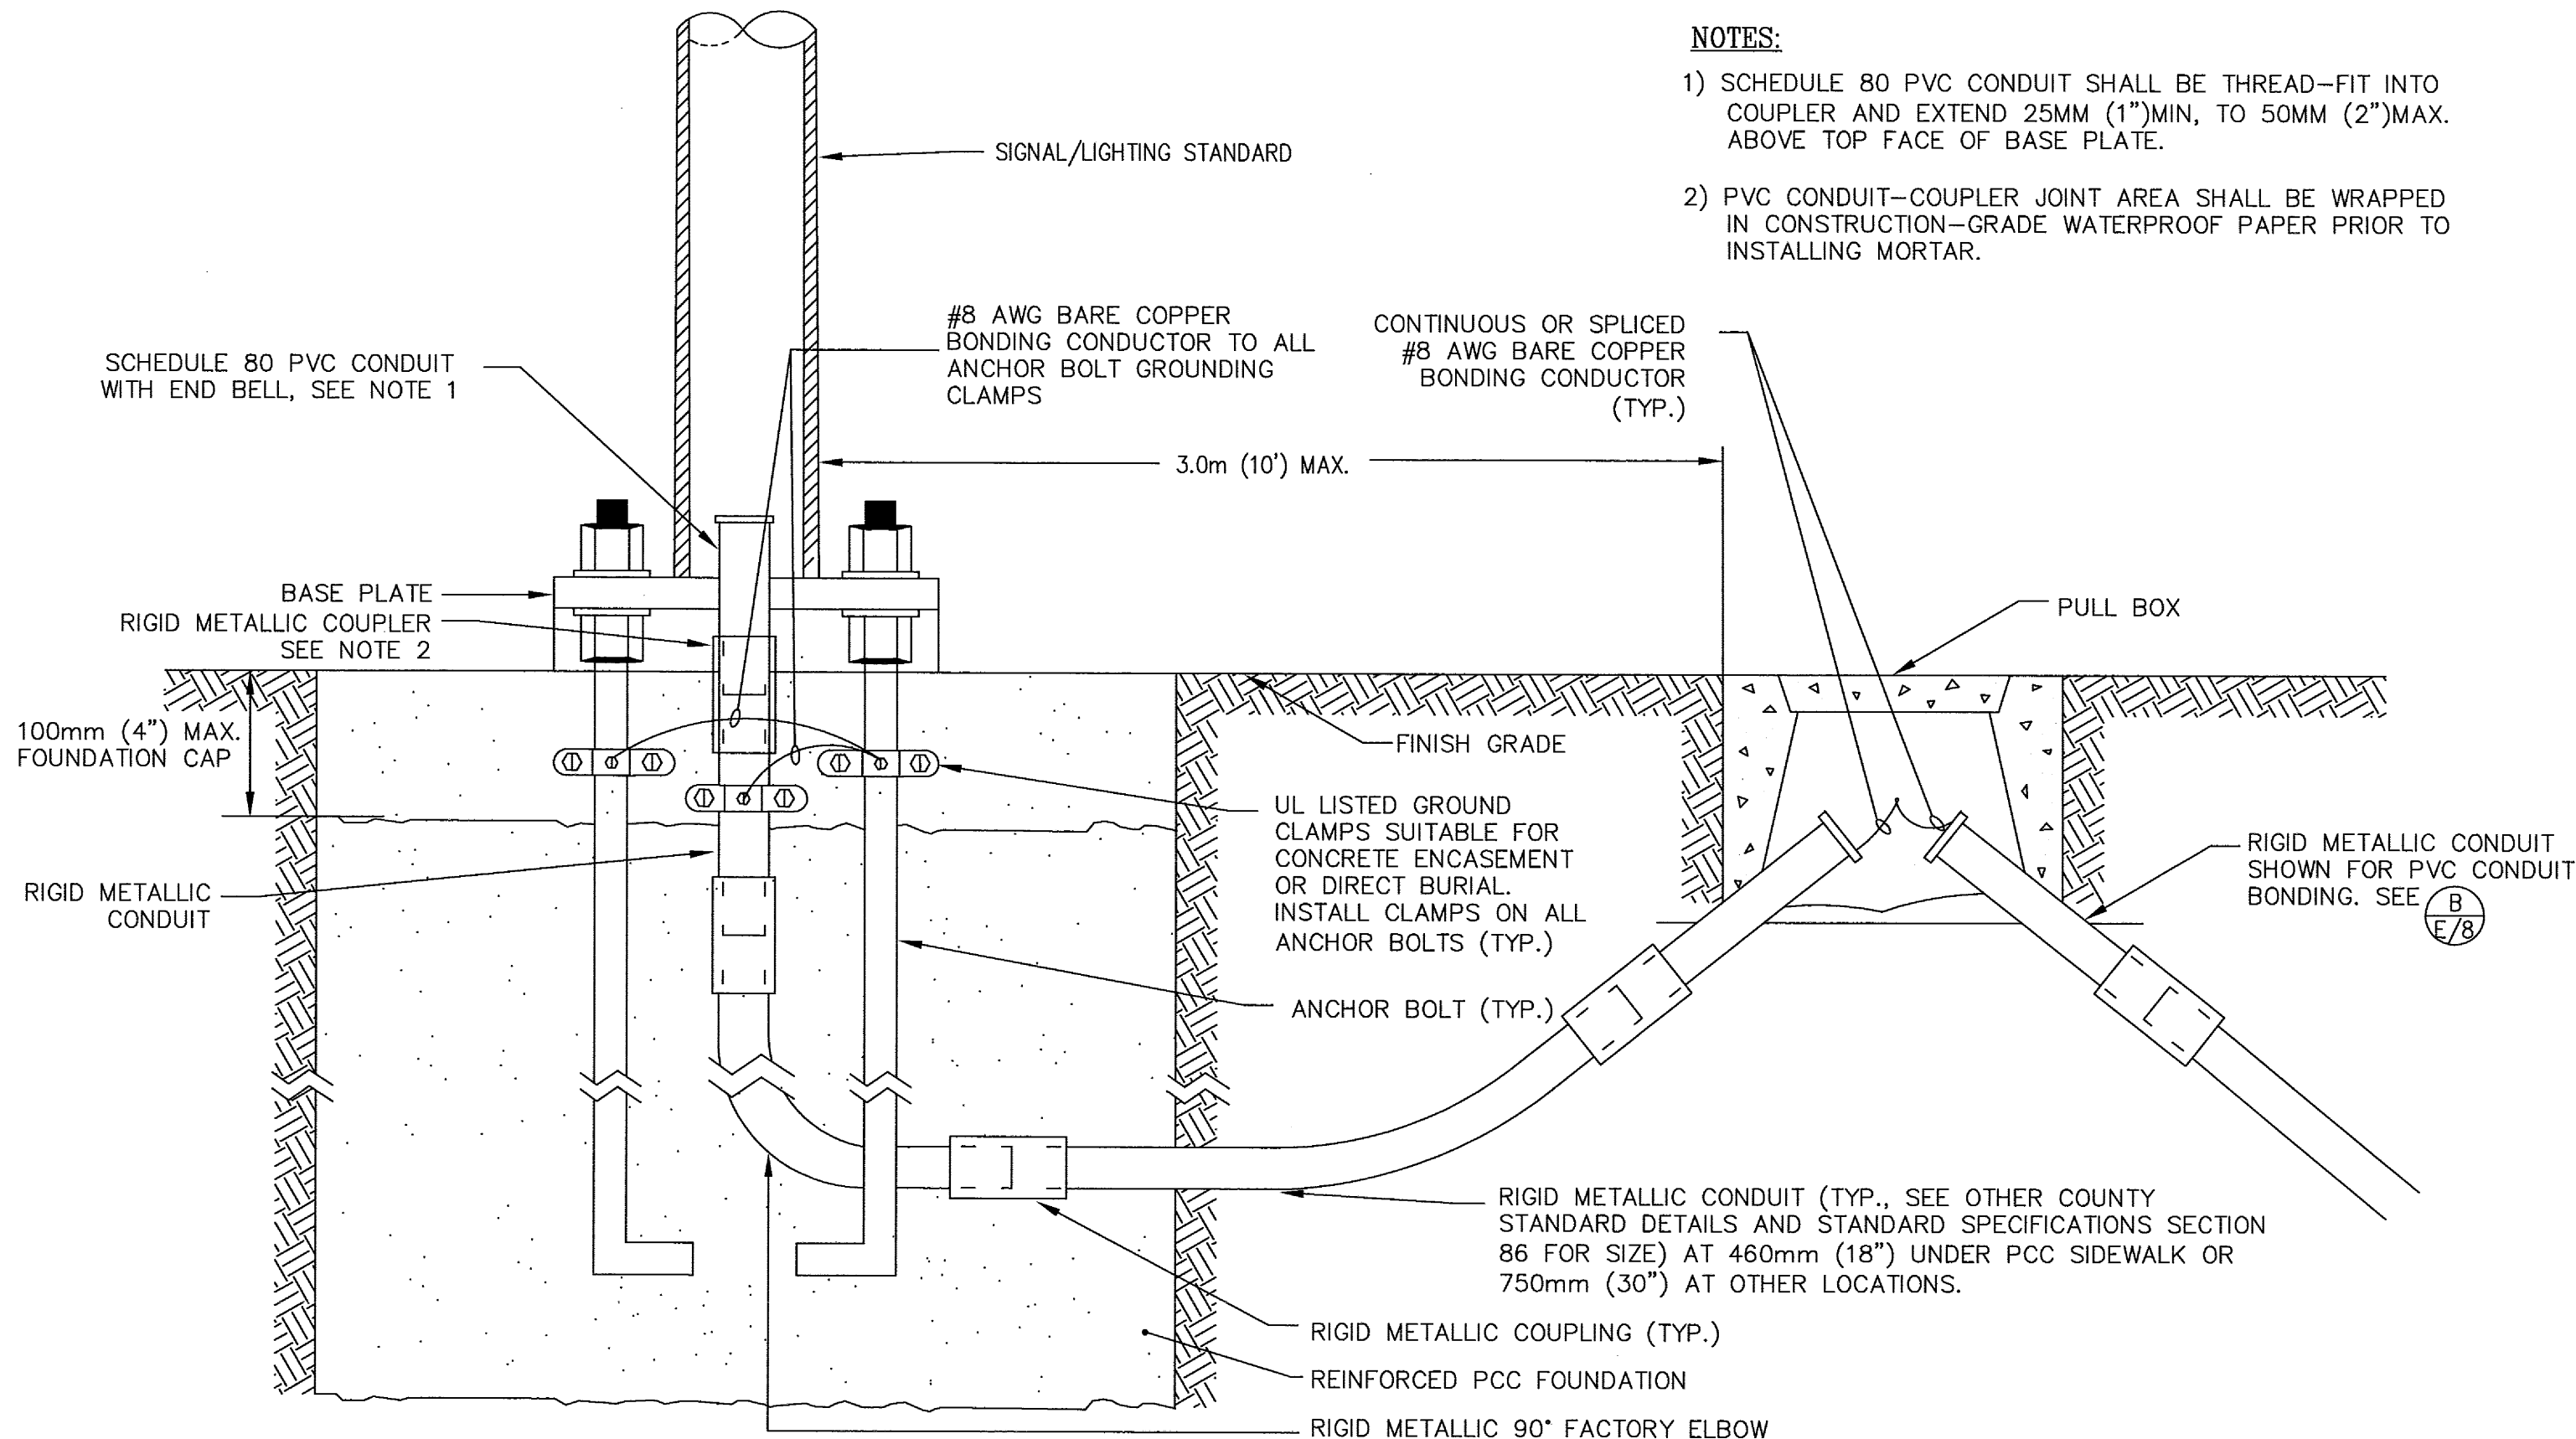

SANTA CLARA COUNTY ROADS AND AIRPORTS DEPARTMENT

DESIGNED TH 11/30/10	DATE 11/30/10	WORK ORDER	SUBMITTED: TONG HONG SENIOR CIVIL ENGINEER
DRAWN RD 11/30/10	DATE 11/30/10	LEVEL BOOK	
CHECKED TH 11/30/10	DATE 11/30/10	TRANSIT BOOK	

12-15-10

STANDARD DETAILS POLE AND CONDUIT BONDING			DRAWING NO. E
PROJECT NO.			47
CONTRACT NO.			SHEET NO. 1 of 1
FILE NO.			